


## Guidance Note 5 – Typical Connection Configurations

### Introduction

The connections shown here in schematic form, are the typical options used to connect AquaCell units to control chambers. They provide a controlled feed into and out of the AquaCell units, and are used for either infiltration or attenuation schemes.

### Manifold Connection


#### Using standard pipes and fittings

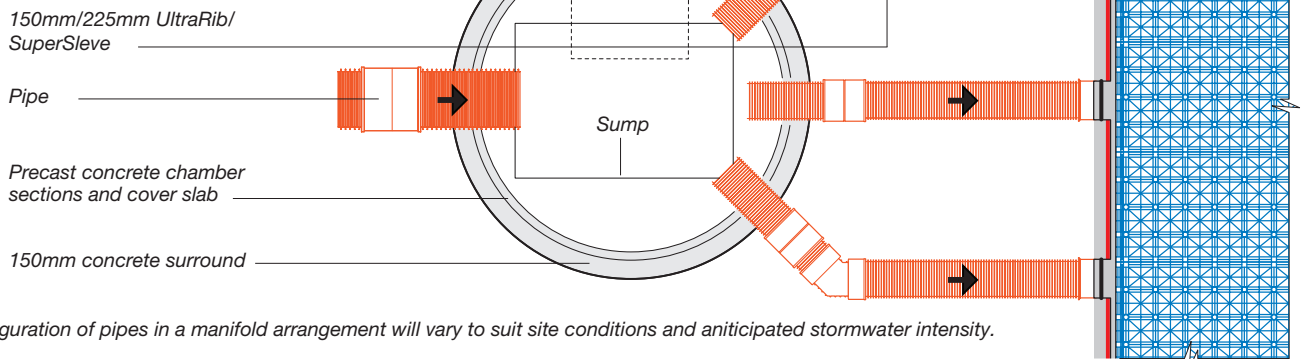

NOTE: The configuration of pipes in a manifold arrangement will vary to suit site conditions and anticipated stormwater intensity.

### Box Connection

#### Using AquaCell units for fast water transfer

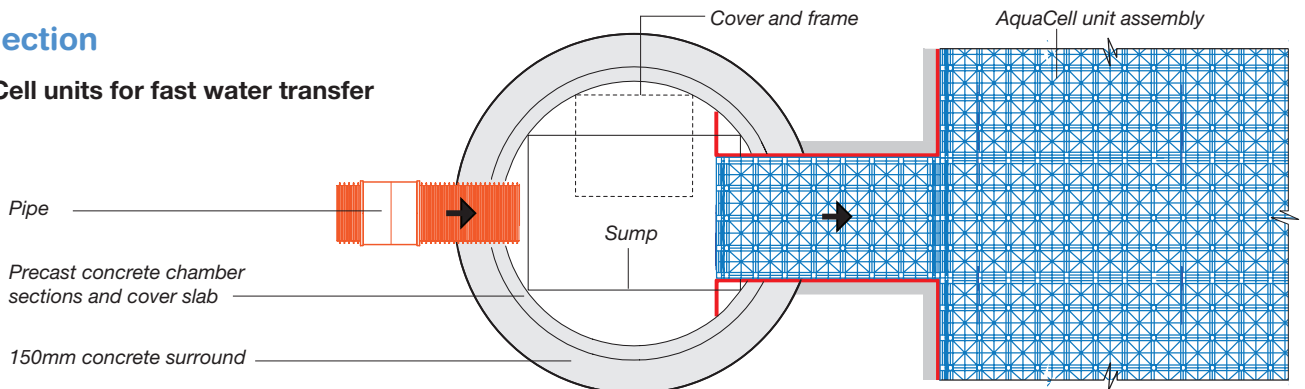

### Central Pipe Connection

#### Using standard perforated Wavin TwinWall pipe and fittings

